


NOTES:

1. INSTALL 9 GA. LADDER TYPE JOINT REINFORCEMENT IN FIRST TWO JOINTS ABOVE OPENING FROM CONTROL JOINT TO CONTROL JOINT.
2. INSTALL 9 GA. LADDER TYPE JOINT REINFORCEMENT IN FIRST OR SECOND MORTAR JOINT BELOW SILL FROM CONTROL JOINT TO CONTROL JOINT.
3. LINTEL DESIGN IS BASED ON ARCHING ACTION AND SO CONTROL JOINTS MUST BE SPACED A MINIMUM OF 3'-4" FROM THE JAMB OF THE OPENING.
4. REINFORCEMENT SCHEDULE IS BASED ON A MAXIMUM HORIZONTAL LOAD OF 5 PSF, AS REQUIRED BY IBC SECTION 1607.15, ALONG WITH A LOAD FACTOR OF 1.6. WALL IS ASSUMED TO BE SIMPLY SUPPORTED WITH A SUPPORT AT THE BASE AND TOP OF WALL.

PARTITION SCHEDULE	
NOMINAL THICKNESS	MAXIMUM HEIGHT
6-INCH	15'-4"
8-INCH	18'-0"
12-INCH	22'-8"

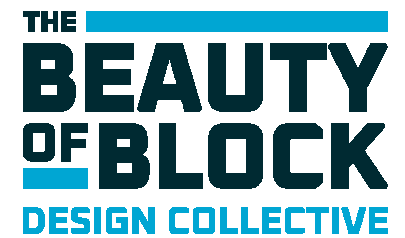

DISCLAIMER: The Block Design Collective ("BDC") does not make any representations or warranties with respect to the accuracy or suitability of this information, and persons making use of this information do so at their own risk. BDC disclaims liability for damages of any kind, including any special, indirect, or consequential damages, which may result from use of this information. This information is not to be interpreted as indicating compliance with, or waiver of, any applicable building code, ordinance, standard or law.

10 PARTITION SCHEDULE

SCALE: 1/4" = 1'-0"